

Ultra-Aire™ XT205H Ventilating Dehumidifier

The Ultra-Aire XT205H is the largest capacity whole house residential dehumidifier on the market. The unit removes up to 205 pints of water per day and retains the same cabinet size as the XT105H and the XT155H. Ideally suited for large homes with high ceilings, the XT205H effectively conditions inside humid air and provides the proper amount of fresh air ventilation for homes up to 5,000 square feet.



MADE IN USA

PATENTS:
D570,988
8,069,681

Ultra-Aire XT205H Specifications

Part Number:	4031560
Blower:	526 CFM @ 0.0" WG 458 CFM @ 0.4" WG
Power:	1525 Watts @ 80°F and 60% RH
Supply Voltage:	110-120 VAC – 1 Phase – 60 Hz. Unit requires dedicated 20 Amp circuit
Current Draw:	13.2 Amps
Energy Factor:	2.7 L/kWh
Operating Range:	56°F Min, 95°F Max (inlet Air Temperature)
Sized For:	5000 Square Foot Typical
Minimum Performance @ 80°F and 60% RH:	
Water Removal:	205 Pints/Day
Efficiency:	5.7 Pints/kWh
UA-XT205H Duct Connections:	
	6" Round Inlet; 10" Round Inlet; 10" Oval Outlet
Air Filter:	Standard MERV-11; Size: 16" x 20" x 2" Efficiency: 65% ASHRAE Dust Spot Test Optional MERV-14, Size: 20" x 24" x 4" Efficiency: 95% ASHRAE Dust Spot Test
Power Cord:	10', 110-120 VAC, Ground
Drain Connection:	3/4" Threaded NPT
UA-XT205H Dimensions:	20.25"W x 21.75"H x 38"L – 150 lbs.



One of the best Limited Warranties in the industry today –

1 YEAR 100% – All Parts and Labor
5 YEARS 100% – Condenser, Evaporator, and Compressor only (with certain limitations)


Optional Accessories

4028539	DEH 3000 Control
4021475	MERV 11 Filter (16x20x2)
4027420	MERV 11 Filters 4-Pack
4027424	MERV 11 Filters 12-Pack
4028614	Pump Kit
4032221	MERV 14 Filter Housing
4024370	MERV 14 Filter (20"x24"x4")
4029087	MERV 14 Filter 3-Pack
4023672	6" Motorized Damper
4026859	6" Flex Duct 25'
4020128	6" Flex Insulated Duct 25'
4020656	6" Inlet/Exhaust Hood
4024375	10" Gravity Damper
4026969	10" Flex Duct 25'
4022126	10" Flex Insulated Duct 25'
4028399	10" Oval to Round Adapter

It's not a dream home
without


Ultra-Aire™

Ultra-Aire™ XT205H Installation Options

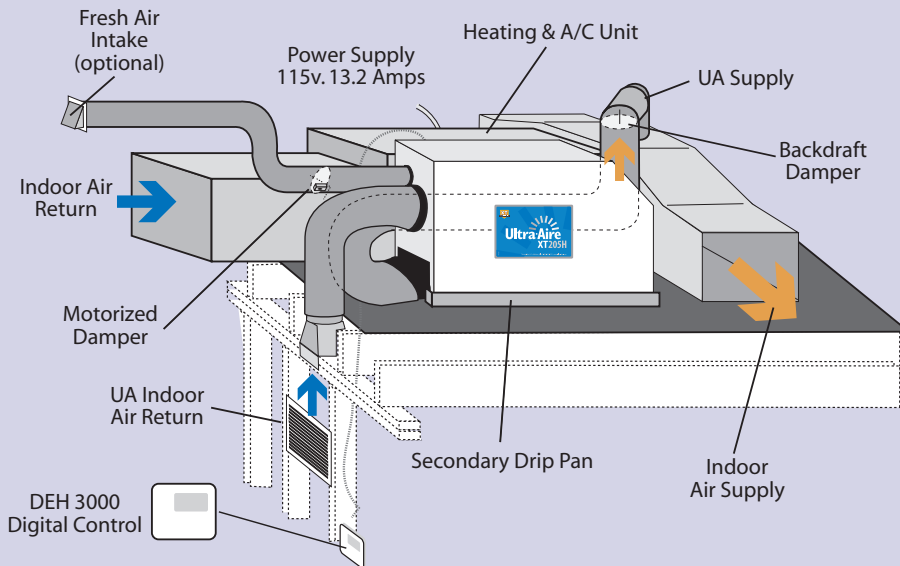

Ultra-Aire XT205H Attic Installation

1. The indoor air return should come from an open area on the first floor or main level of the home / building.
2. The Ultra-Aire supply can be ducted into the forced air system past the air conditioning coil. The duct connection should be perpendicular to the air flow. You may also run an independent supply directly from the dehumidifier into a large open room. Depending on the application, multiple returns and or supplies may be needed.
3. The optional six inch fresh air intake should be located at least six feet away from any exhaust ports, such as, dryer, range hood, or combustion device exhaust. Intake location should be consistent with local codes.
4. A section of flex duct or vibration absorbing duct should be located between the connections of the Ultra-Aire ductwork and the forced air system ductwork. (When ducting into the forced air systems)
5. A back draft damper should be installed when ducting into the forced air system. This prevents counter-flow of the A/C supply air through the UA XT205H. A back draft damper is not needed when ducted independently.
6. If placed over a finished area, a secondary drip pan is recommended

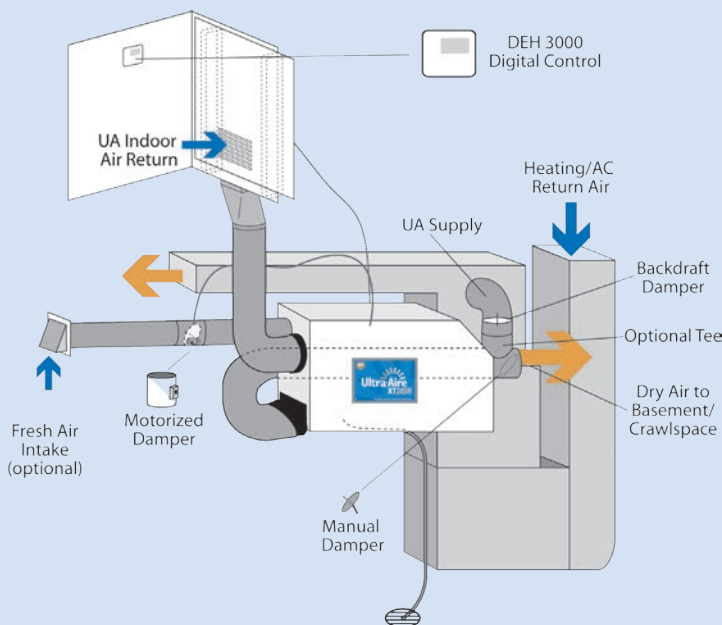

Ultra-Aire XT205H Basement Or Crawlspace Installation

1. Indoor air return should come from an open area of the first or second floor.
2. The Ultra-Aire supply should be ducted into the forced air system supply beyond the air conditioning coil. The duct connection should be perpendicular to the air flow.
3. An optional ten inch tee fitting with an adjustable blade damper on the straight run may be attached at the Ultra-Aire supply. This allows for increased air flow to the basement/crawlspace during the summer months.
4. The optional six inch fresh air intake should be located at least six feet away from any exhaust ports, such as, dryer, range hood, or combustion device exhaust. Intake location must be consistent with local codes.
5. A section of flex duct or vibration absorbing duct should be located between the connections of the Ultra-Aire ductwork and the forced air system ductwork.
6. The backdraft damper prevents counter-flow of the A/C supply air through the Ultra-Aire XT205H.

Please Note: Therma-Stor does not recommend drawing air from the return ducting system and discharging into the supply, because it could reduce the capacity and may cause potential counterflow through the unit. Preferred installation is to draw air from a separate intake duct located in the central part of the home. Duct the outlet air into the supply duct for distribution throughout the home. A backdraft damper prevents air from the supply duct from being pushed backward through the Ultra-Aire XT205H when central (A/C) fan is on and the Ultra-Aire fan is off.

To Buy: Visit www.sylvane.com or call 800-934-9194
For Technical Support: Contact Therma-Stor at 800-533-7533